

Fuel Pump Flushing & Valve Installation 2026-03-10 / PLC_1 [CPU 1215C DC/DC/DC] / Program blocks


HMI_Switch [FB1]

HMI_Switch Properties

General							
Name	HMI_Switch	Number	1	Type	FB	Language	LAD
Numbering	automatic						
Information							
Title		Author		Comment		Family	
Version	0.1	User-defined ID					


HMI_Switch							
Name	Data type	Default value	Retain	Accessible from HMI	Visible in HMI	Setpoint	Comment
Input							
Output							
InOut							
Static							
Temp							
Constant							

Network 1:

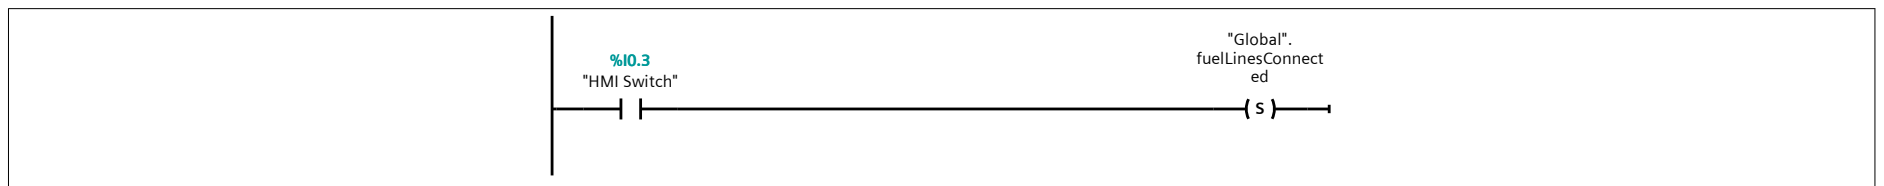

Symbol	Address	Type	Comment
"Global".fuelLinesConnected		Bool	
"HMI Switch"	%I0.3	Bool	

Network 2:

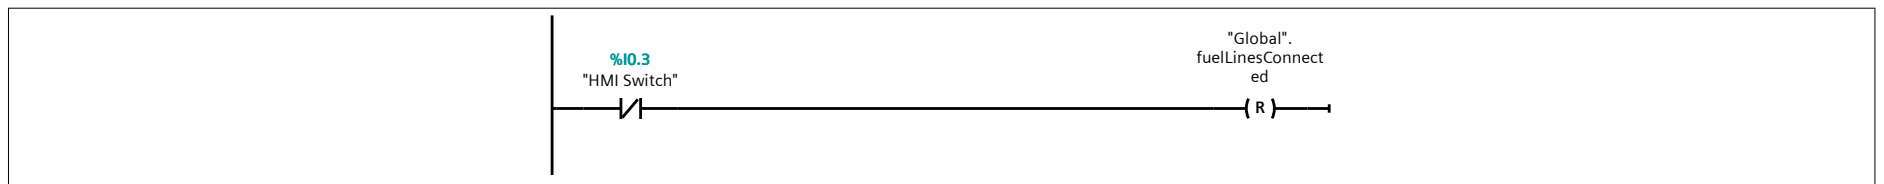

Symbol	Address	Type	Comment
"Global".fuelLinesConnected		Bool	
"HMI Switch"	%I0.3	Bool	